


- GENERAL NOTES:
1. ALL HANDRAILS SHALL TERMINATE AT A POST OR NEWEL ON BOTH ENDS.
 2. SD/SMD REFERS TO LOCATION OF HARDWIRED SMOKE AND CARBON MONOXIDE DETECTORS.
 3. NEW TOILETS SHALL NOT EXCEED 1.28 GALLONS PER EFFECTIVE FLUSH.
 4. SHOWER HEAD SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 2.0 GALLONS PER MINUTE AT 80 PSI.
 5. MULTIPLE SHOWER HEADS SERVING ONE SHOWER SHALL NOT HAVE A COMBINED FLOW RATE OF NOT MORE THAN 2.0 GALLONS PER MINUTE AT 80 PSI.
 6. FAUCETS SHALL HAVE A MAXIMUM FLOW RATE OF NOT MORE THAN 1.5 GALLONS PER MINUTE AT 60 PSI.
 7. LOCATION OF BATHROOM FAN. FAN SHALL BE ENERGY STAR COMPLIANT AND MUST BE CONTROLLED BY A HUMIDITY CONTROL. THE CONTROL SHALL BE CAPABLE OF ADJUSTMENT BETWEEN A RELATIVE HUMIDITY RANGE OF 50% TO A MAXIMUM OF 80%. THE CONTROL IS NOT REQUIRED TO BE INTEGRAL TO THE FAN.

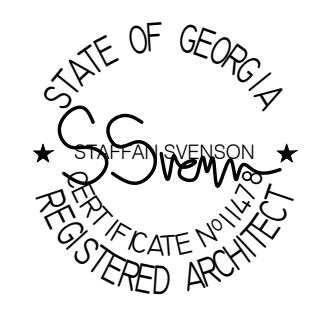

JUSTICE KOHLSDORF RESIDENCE
6075 GREENPINE DRIVE
SANDY SPRING, GEORGIA 30042

NO.	DATE	DESCRIPTION
1	10/15/2021	BUILDING PLAN - REVIEW COMMENTS
2	02/24/2022	BUILDING PLAN - REVIEW COMMENTS
3	01/18/2021	BUILDING PLAN - REVIEW COMMENTS
4	03/09/2021	
5	01/04/2022	
6	02/07/2022	
7	02/10/2022	
8	04/10/2022	

2020 NOVEMBER 18 2020

1 SITEPLAN

scale: 1/16" = 1'-0"

A
1-0